



EasySep™ Mouse Pan-ILC Enrichment Kit

Negative Selection
Catalog #19875

For processing 1 x 10⁹ cells



Scientists Helping Scientists™ | WWW.STEMCELL.COM

TOLL FREE PHONE 1 800 667 0322 • PHONE +1 604 877 0713
INFO@STEMCELL.COM • TECHSUPPORT@STEMCELL.COM
FOR GLOBAL CONTACT DETAILS VISIT OUR WEBSITE

Document #DX21925 | Version 1_0_0

Description

Enrich untouched group 1, 2, and 3 innate lymphoid cells (ILC1, 2, and 3) from mouse lung or lymph node by immunomagnetic negative selection. When using single-cell suspensions from other tissue types, this kit may require optimization.

- Fast, easy-to-use and column-free
- Isolated cells are untouched
- Facilitates rapid flow sorting of ILCs

This kit targets non-ILCs for removal with biotinylated antibodies recognizing specific cell surface markers. Unwanted cells are labeled with biotinylated antibodies and magnetic particles, and separated without columns using an EasySep™ magnet. Desired cells are simply poured off into a new tube. Isolated cells are immediately available for downstream applications such as flow cytometry or cell sorting.

Component Descriptions

COMPONENT NAME	COMPONENT #	QUANTITY	STORAGE	SHELF LIFE	FORMAT
EasySep™ Mouse Pan-ILC Enrichment Cocktail	19875C	1 x 0.5 mL	Store at 2 - 8°C. Do not freeze.	Stable until expiry date (EXP) on label.	A combination of monoclonal antibodies in PBS and 0.1% BSA.
EasySep™ Streptavidin RapidSpheres™ 50001	50001	1 x 1 mL	Store at 2 - 8°C. Do not freeze.	Stable until expiry date (EXP) on label.	A suspension of magnetic particles in water.

BSA - bovine serum albumin; PBS - phosphate-buffered saline

Components may be shipped at room temperature (15 - 25°C) but should be stored as indicated above.

Sample Preparation

LUNG TISSUE

The following instructions are for processing 5 - 10 mouse lungs. If starting with more than 10 lungs, adjust volumes accordingly.

1. Prepare 10 mL of digestion medium by adding 1 mL of Collagenase/Hyaluronidase (Catalog #07912) and 1.5 mL of DNase I Solution (Catalog #07900) to 7.5 mL of RPMI 1640 Medium (Catalog #36750). Warm to room temperature (15 - 25°C).
2. Harvest lung tissue into a conical tube containing PBS with 2% fetal bovine serum (FBS).
3. Transfer lung tissue to a conical tube containing 10 mL of digestion medium and mince the tissue into small pieces using scissors. Incubate at 37°C for 20 minutes on a shaking platform.
4. Place a 70 µm nylon mesh strainer over a 100 mm Petri Dish (Catalog #27110) and push the digested lung tissue through strainer with the rubber end of a syringe plunger to obtain a cell suspension.
5. Place a new 70 µm nylon mesh strainer over a 50 mL conical tube and filter the cell suspension through it. Rinse the strainer with recommended medium and collect in the same tube.
6. Centrifuge at 300 x g for 10 minutes at room temperature with the brake on low. Carefully remove and discard the supernatant.
7. Add 20 mL of Ammonium Chloride Solution (Catalog #07800) to the cell pellet. Incubate at room temperature for 5 minutes.
8. Top up to 50 mL with recommended medium. Centrifuge at 300 x g for 10 minutes at room temperature with the brake on low. Carefully remove and discard the supernatant.
9. Resuspend cells at 1 x 10⁸ cells/mL in recommended medium.

LYMPH NODE

Harvest lymph node and transfer to a 70 µm nylon mesh strainer that is placed over a 100 mm Petri Dish (Catalog #27110) containing recommended medium. Push the lymph node tissue through strainer with the rubber end of a syringe plunger to obtain a cell suspension. Centrifuge at 300 x g for 10 minutes and resuspend at 1 x 10⁸ cells/mL in recommended medium. Ammonium chloride treatment is not required when preparing the cells for separation.


Recommended Medium

EasySep™ Buffer (Catalog #20144), or PBS containing 2% FBS and 1 mM EDTA. Medium should be free of Ca⁺⁺, Mg⁺⁺, and biotin.

Directions for Use – Manual EasySep™ Protocols

See page 1 for Sample Preparation and Recommended Medium. Refer to Tables 1 and 2 for detailed instructions regarding the EasySep™ procedure.



Table 1. EasySep™ Mouse Pan-ILC Enrichment Kit Protocol

		EASYSEP™ MAGNET
STEP	INSTRUCTIONS	 EasySep™ (Catalog #18000)
1	Prepare sample within the volume range.	1 x 10 ⁸ cells/mL 0.3 - 1 mL NOTE: If starting with fewer than 5 x 10 ⁷ cells, resuspend cells in 0.3 mL.
	Add sample to required tube.	5 mL (12 x 75 mm) polystyrene round-bottom tube (e.g. Catalog #38007)
2	Add Enrichment Cocktail to sample.	50 µL/mL of sample
	Mix and incubate.	RT for 5 minutes
3	Vortex RapidSpheres™. NOTE: Particles should appear evenly dispersed.	30 seconds
4	Add RapidSpheres™ to sample.	75 µL/mL of sample
	Mix and incubate.	RT for 5 minutes
5	Add recommended medium to top up sample to the indicated volume. Mix by gently pipetting up and down 2 - 3 times.	Top up to 2.5 mL
	Place the tube (without lid) into the magnet and incubate.	RT for 3 minutes
6	Pick up the magnet, and in one continuous motion invert the magnet and tube,* pouring the enriched cell suspension into a new tube.	Use a new 14 mL tube
7	Remove the tube from the magnet and add recommended medium to indicated volume. Mix by gently pipetting up and down 2 - 3 times.	Top up to 2.5 mL
	Place the tube (without lid) into the magnet and incubate.	RT for 3 minutes
8	Pick up the magnet, and in one continuous motion invert the magnet and tube,* pouring off the enriched cell suspension.	Combine with poured-off fraction from step 6 Isolated cells are ready for use

RT - room temperature (15 - 25°C)

* Leave the magnet and tube inverted for 2 - 3 seconds, then return upright. Do not shake or blot off any drops that may remain hanging from the mouth of the tube.

Table 2. EasySep™ Mouse Pan-ILC Enrichment Kit Protocol

STEP	INSTRUCTIONS	EASYSEP™ MAGNETS	
		 EasyPlate™ (Catalog #18102)	 EasyEights™ (Catalog #18103) 5 mL tube
1	Prepare sample at the indicated cell concentration within the volume range.	1 x 10 ⁸ cells/mL 0.025 - 0.2 mL	1 x 10 ⁸ cells/mL 0.3 - 1 mL NOTE: If starting with fewer than 5 x 10 ⁷ cells, resuspend cells in 0.3 mL.
	Add sample to required tube (or plate when using the EasyPlate™ EasySep™ Magnet).	Round-bottom, non-tissue culture-treated 96-well plate (e.g. Catalog #38018)	5 mL (12 x 75 mm) polystyrene round-bottom tube (e.g. Catalog #38007)
2	Add Enrichment Cocktail to sample.	50 µL/mL of sample	50 µL/mL of sample
	Mix and incubate.	RT for 5 minutes	RT for 5 minutes
3	Vortex RapidSpheres™. NOTE: Particles should appear evenly dispersed.	30 seconds	30 seconds
4	Add RapidSpheres™ to sample.	75 µL/mL of sample	75 µL/mL of sample
	Mix and incubate.	RT for 5 minutes	RT for 5 minutes
5	Add recommended medium to top up sample to the indicated volume. Mix by gently pipetting up and down 2 - 3 times.	Top up to 0.25 mL	Top up to 2.5 mL
	Place the tube or plate (without lid) into the magnet and incubate.	RT for 10 minutes	RT for 3 minutes
6	Carefully pipette** (do not pour) the enriched cell suspension into a new tube or plate.	Use a new 96-well plate Isolated cells are ready for use	Use a new 14 mL tube
7	Remove the tube from the magnet and add recommended medium to indicated volume. Mix by gently pipetting up and down 2 - 3 times.	---	Top up to 2.5 mL
	Place the tube (without lid) into the magnet and incubate.	---	RT for 3 minutes
8	Pick up the magnet, and in one continuous motion invert the magnet and tube,** pouring off the enriched cell suspension.	---	Combine with poured-off fraction from step 6 Isolated cells are ready for use

RT - room temperature (15 - 25°C)

** Collect the entire supernatant, all at once, into a single pipette (for EasyEights™ 5 mL tube use a 2 mL serological pipette [Catalog #38002]).

Notes and Tips

ASSESSING PURITY

ILCs are defined as CD45-positive, lineage-negative (see below for lineage-specific labeling), and CD127-positive.

NOTE: Subsets of ILCs are further characterized as follows: ILC1s are CD278-CD117-, ILC2s are CD278+CD117+/-, and ILC3s are CD278-CD117+.

For purity assessment of ILCs by flow cytometry, use the following fluorochrome-conjugated antibody clones:


- Anti-Mouse CD45 Antibody, Clone 30-F11 (Catalog #60030), and
- Anti-mouse CD278 (ICOS) antibody, clone C3.98.4A, and
- Anti-mouse CD127 antibody, clone A7R34. and
- Anti-mouse CD117 (c-Kit) antibody, clone 2B8, and
- Anti-mouse lineage-specific antibodies (see below)

For lineage-specific antigen labeling, use the following fluorochrome-conjugated antibody clones:

- Anti-Mouse CD3e Antibody, Clone 145-2C11 (Catalog #60015), and
- Anti-Mouse CD11b Antibody, Clone M1/70 (Catalog #60001), and
- Anti-Mouse CD11c Antibody, Clone N418 (Catalog #60002), and
- Anti-Mouse CD19 Antibody, Clone 1D3 (Catalog #60112), and
- Anti-Mouse Gr-1 Antibody, Clone RB6-8C5 (Catalog #60028), and
- Anti-Mouse TER119 Antibody, Clone TER-119 (Catalog #60033), and
- Anti-mouse TCR beta chain antibody, clone H57-597, and
- Anti-Mouse TCR Gamma/Delta Antibody, Clone GL3 (Catalog #60104)

Data


A Lung

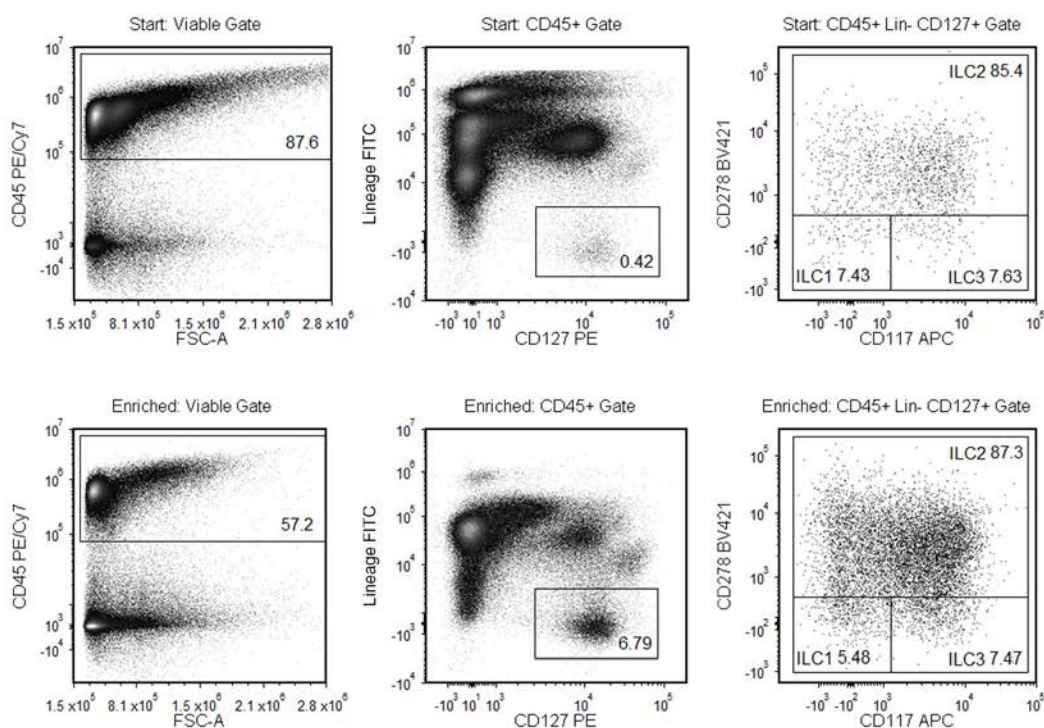

Starting with a naïve mouse lung single-cell suspension, the total ILC content (CD45+Lin-CD127+) of the enriched fraction typically ranges from 3.1 - 7.6%. In the above example, the percentages of ILCs in the start and final enriched fractions are 0.4% and 3.9% (or 0.4% and 6.8% of CD45+ cells), respectively.

NOTE: The ILC content of the start fraction typically ranges from 0.3 - 0.6%.

B Lymph Node

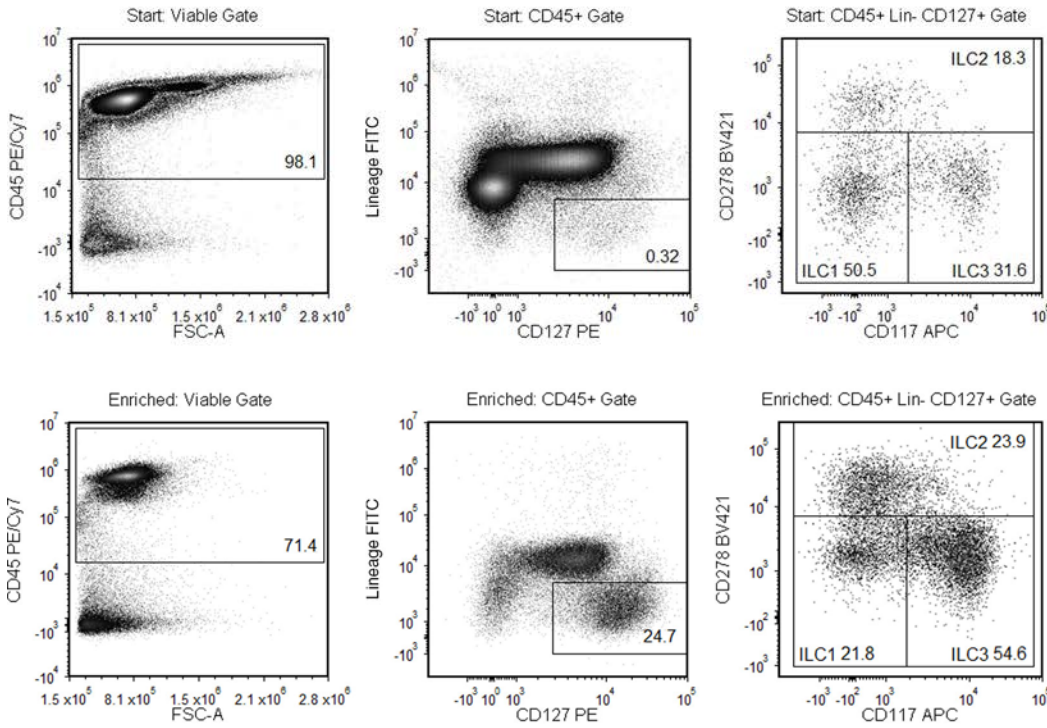

Starting with a naïve mouse lymph node single-cell suspension, the total ILC content (CD45+Lin-CD127+) of the enriched fraction typically ranges from 21.1 - 45.2%. In the above example, the percentages of ILCs in the start and final enriched fractions are 0.3% and 17.6% (or 0.3% and 24.7% of CD45+ cells), respectively.

NOTE: The ILC content of the start fraction typically ranges from 0.3 - 0.4%.

STEMCELL TECHNOLOGIES INC.'S QUALITY MANAGEMENT SYSTEM IS CERTIFIED TO ISO 13485. PRODUCTS ARE FOR RESEARCH USE ONLY AND NOT INTENDED FOR HUMAN OR ANIMAL DIAGNOSTIC OR THERAPEUTIC USES UNLESS OTHERWISE STATED.

Copyright © 2018 by STEMCELL Technologies Inc. All rights reserved including graphics and images. STEMCELL Technologies & Design, STEMCELL Shield Design, Scientists Helping Scientists, EasyEights, EasySep, EasyPlate, and RapidSpheres are trademarks of STEMCELL Technologies Canada Inc. All other trademarks are the property of their respective holders. While STEMCELL has made all reasonable efforts to ensure that the information provided by STEMCELL and its suppliers is correct, it makes no warranties or representations as to the accuracy or completeness of such information.